

L7E

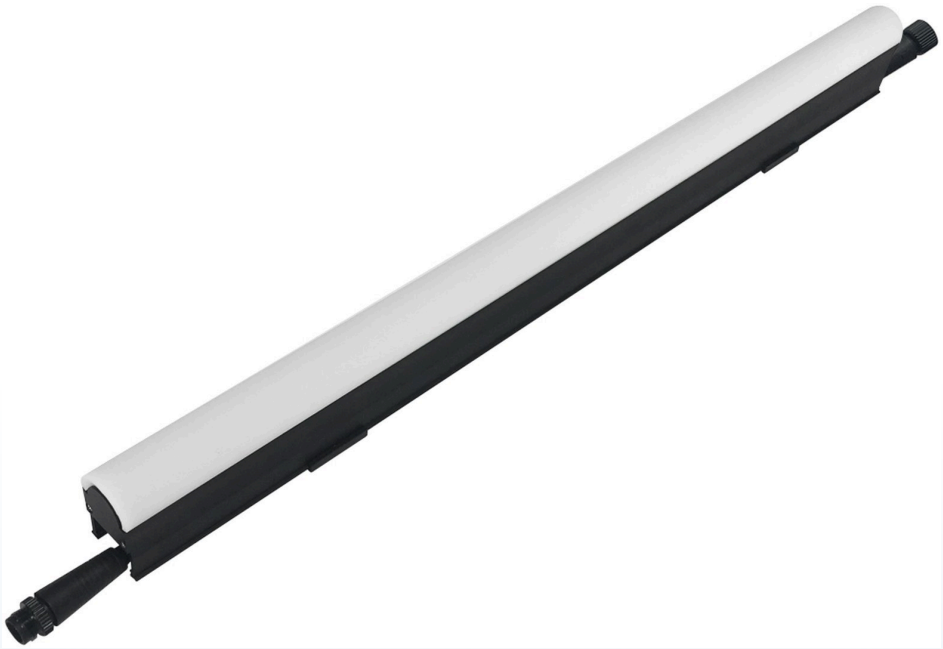

Special lighting fixtures for buildings, tunnels, bridges, gardens, squares, etc.

IP Rating	IK Rating	Water Depth	Mounting Method	Safety Class	Certification Mark	Environmental Mark	Recyclable Mark
IP65	08 (5 kg, 10 cm, 5 J)	ABOVE WATER	SURFACE MOUNTED	Class III	CE	RoHS	RECYCLABLE

DIMENSIONS

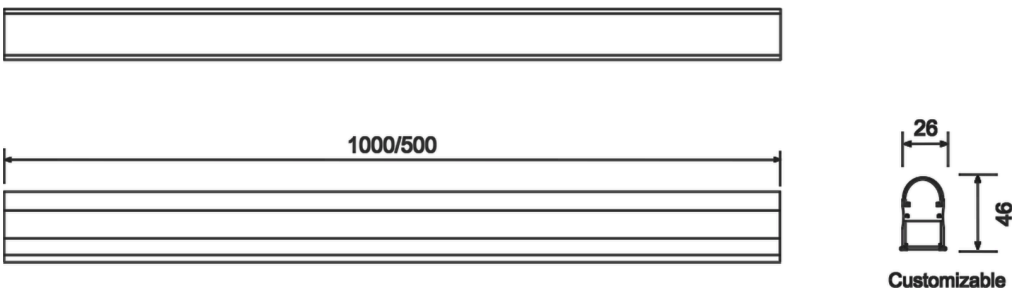

unit: mm


TECHNICAL DATA

L7E

ELECTRICAL	**ELECTRICAL PARAMETERS**	
	Typical Power | Power Consumption	6 W / 12 W
	Input | Current	DC24V
	Control Method | Control	ON OFF/DMX512 / DALI / 0-10V
	Cable Order | Wiring	1 in 1 out
	Security Level | Class	Class III
LIGHT SOURCE	**LED LIGHT SOURCE PARAMETERS**	
	LED Chip Brand | Brand	lumileds
	LED Chip Type | Type	SMD5050 / SMD3535
	LED Quantity | Qty	30PCS /60 PCS
	Colour (CCT) | Colour	2200K/2700K/3000K/4000K/6500K/RGBW
	CRI | Rendering	Ra ≥ 70/Ra ≥ 80/Ra ≥ 90
	Typical Light Efficiency | Efficacy	>80 lm/W (3000K) · >30 lm/W (RGBW)
	Lifetime | Life	50,000 H
STRUCTURE	**STRUCTURAL PARAMETERS**	
	Material | Housing	Aluminum+Silicone
	Cover | Glass	PMMA,
	Beam Angle | Angle	98°
	Product Dimensions | Size	See DIMENSIONS drawing
	Weight | Mass	1.3 kg@1M
ENVIRONMENT	**ENVIRONMENTAL PARAMETERS**	
	Working Temperature | Temp	-25°C ~ +45°C
	Storage Humidity | Humidity	0 ~ 90%
	IP Code | IP	IP65
	IK Code | IK	IK08

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

Beam 98°

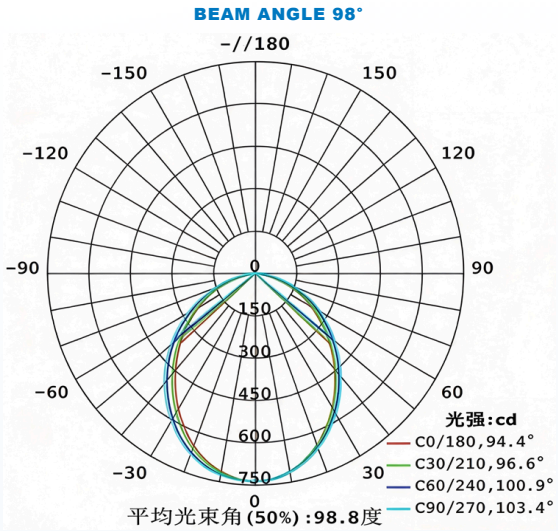

SYSTEM DIAGRAM

WIRING TOPOLOGY


ON/OFF



built-in DMX





DALI 0-10V

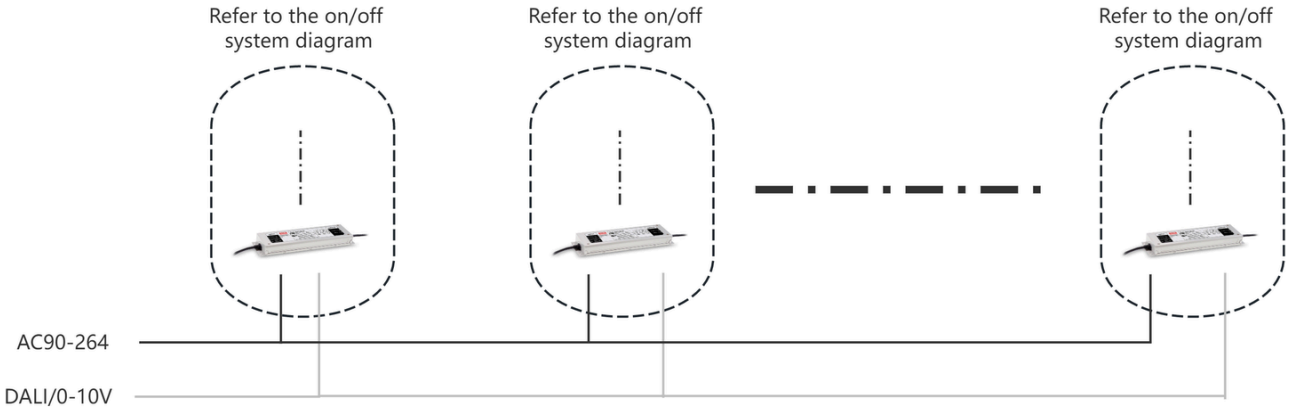

WIRE COLOUR DEFINITION

L7E

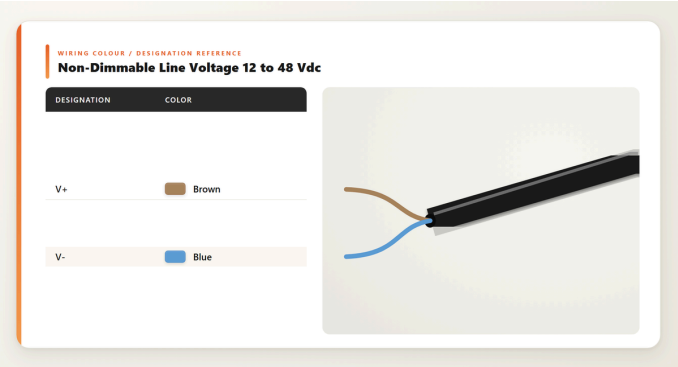

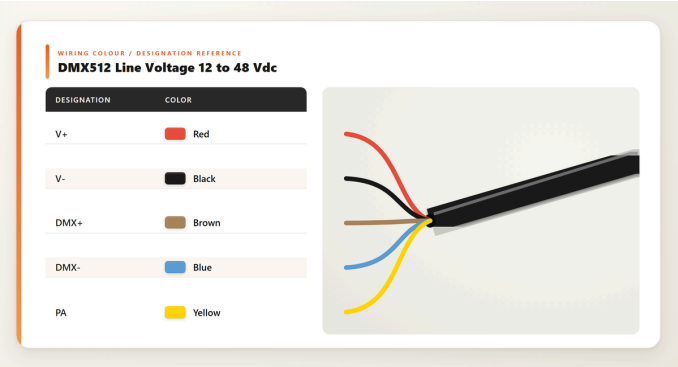

INSTALLATION & USAGE NOTES

PRECAUTIONS

OBSERVE THE FOLLOWING PRECAUTIONS WHEN INSTALLING AND OPERATING THE LUMINAIRE

- Installation and wiring must be carried out by a qualified electrician in accordance with local electrical codes and these instructions.
- Operate the luminaire only on the rated low-voltage DC supply (see Technical Parameters); never connect it directly to mains voltage.
- Do not energise the luminaire out of water for extended periods — dry operation may cause overheating and shorten LED life.
- Inspect cables, seals and glands periodically; damaged sheaths or ageing seals must be replaced immediately by qualified personnel.
- Always isolate the power supply before installation, maintenance or lamp replacement; verify the circuit is de-energised before touching any connector.
- All cable entries, glands and junction boxes must be properly sealed to keep the IP68 rating; use only the supplied or approved waterproof connectors.
- Maintain pool / water-feature water chemistry (pH and chlorine levels) within normal ranges to preserve the SUS316 stainless-steel housing and trims.
- Use only genuine LESAN replacement parts; any unauthorised modification voids the warranty.